
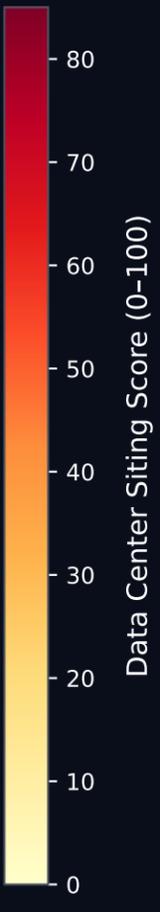


Michigan Data Center Siting Score by County Subdivision

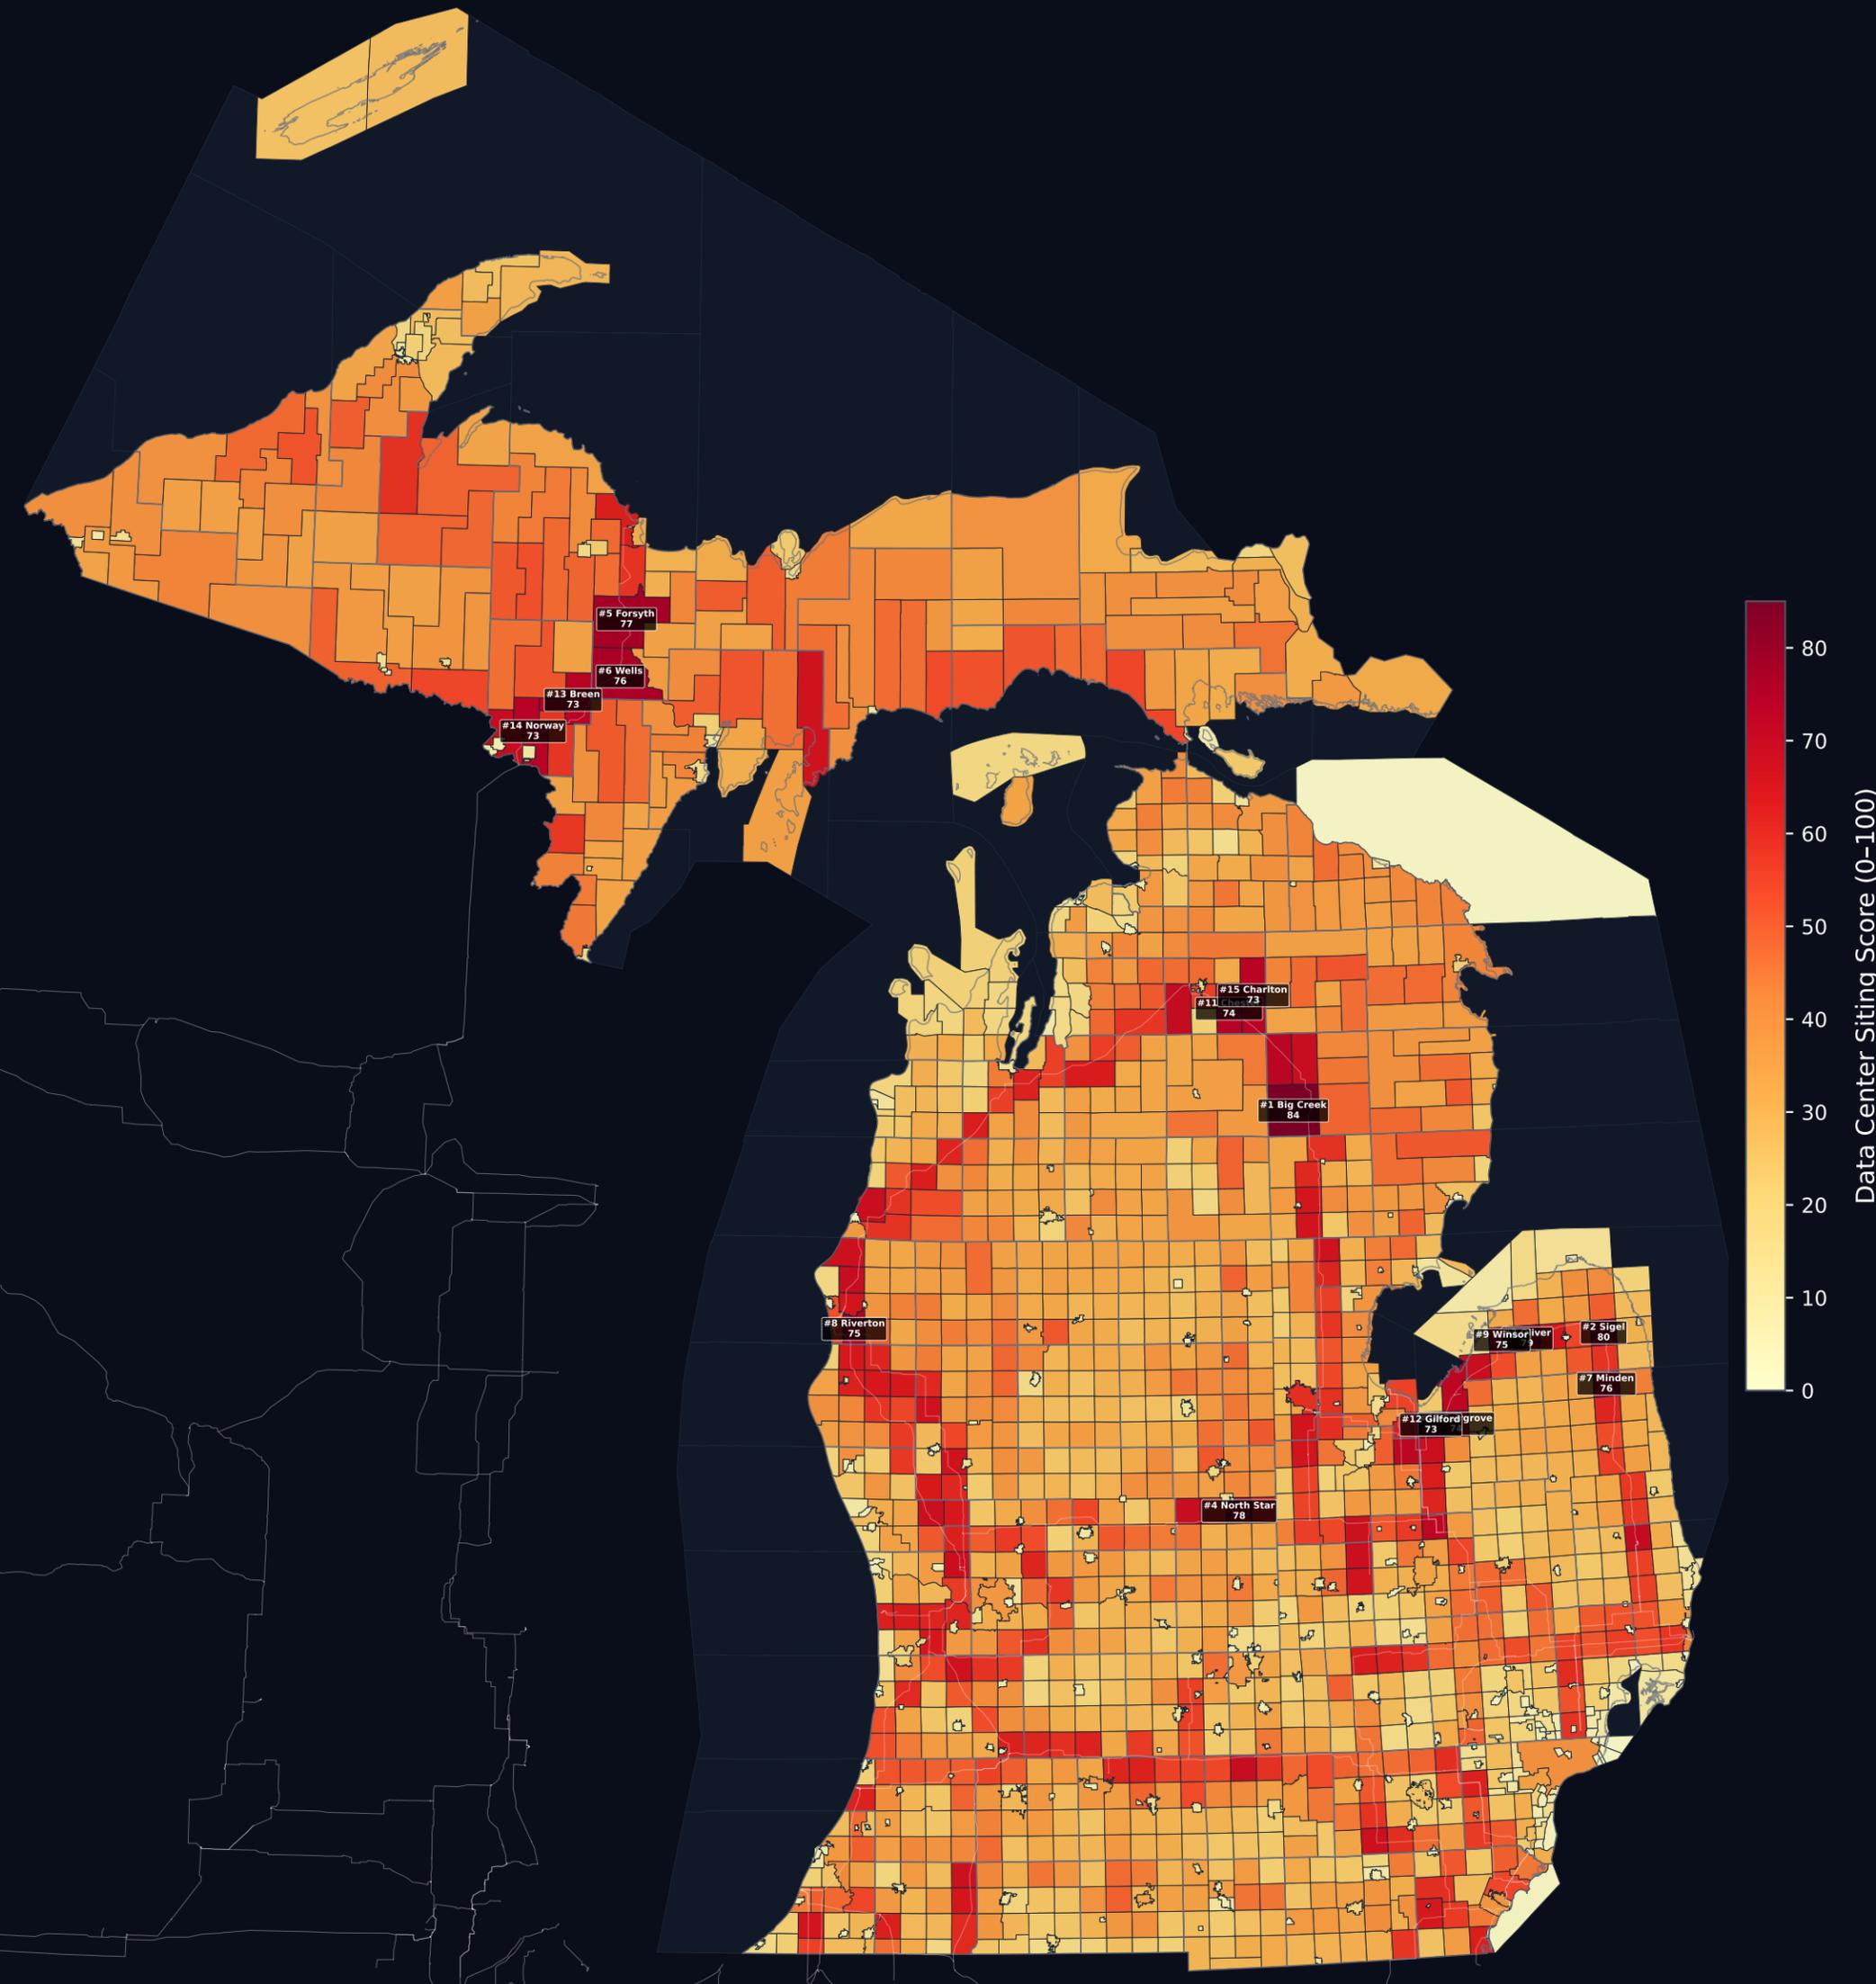

Overlays
 — 345kV+ transmission lines (2,473)
 — County boundaries (83)

Score Interpretation
 75–100 Excellent candidate
 50–74 Good candidate
 25–49 Marginal
 0–24 Poor fit

Score Weights
 35% High-voltage transmission (345kV+)
 20% Renewable energy proximity
 20% Low population density
 15% Land availability
 10% Grid infrastructure